



Certificate of Analysis











COMPLIANCE FOR RETAIL

Sample: DA31228012-010
 Harvest/Lot ID: KND394
 Batch#: KND394
 Seed to Sale# 30ML
 Batch Date: 12/01/23
 Sample Size Received: 2000 mg
 Total Amount: 2000 mg
 Retail Product Size: 2000 mg
 Ordered: 12/20/23
 Sampled: 12/28/23
 Completed: 12/30/23
 Sampling Method: SOP.T.20.010.FL


Dec 30, 2023 | Farmasci Life
 3361 NW 55th St
 Fort Lauderdale, FL, 33309, US

PASSED

Pages 1 of 1

PRODUCT IMAGE	SAFETY RESULTS								MISC.
	 Pesticides NOT TESTED	 Heavy Metals NOT TESTED	 Microbials NOT TESTED	 Mycotoxins NOT TESTED	 Residuals Solvents NOT TESTED	 Filtration NOT TESTED	 Water Activity NOT TESTED	 Moisture NOT TESTED	 Terpenes NOT TESTED

Cannabinoid **PASSED**

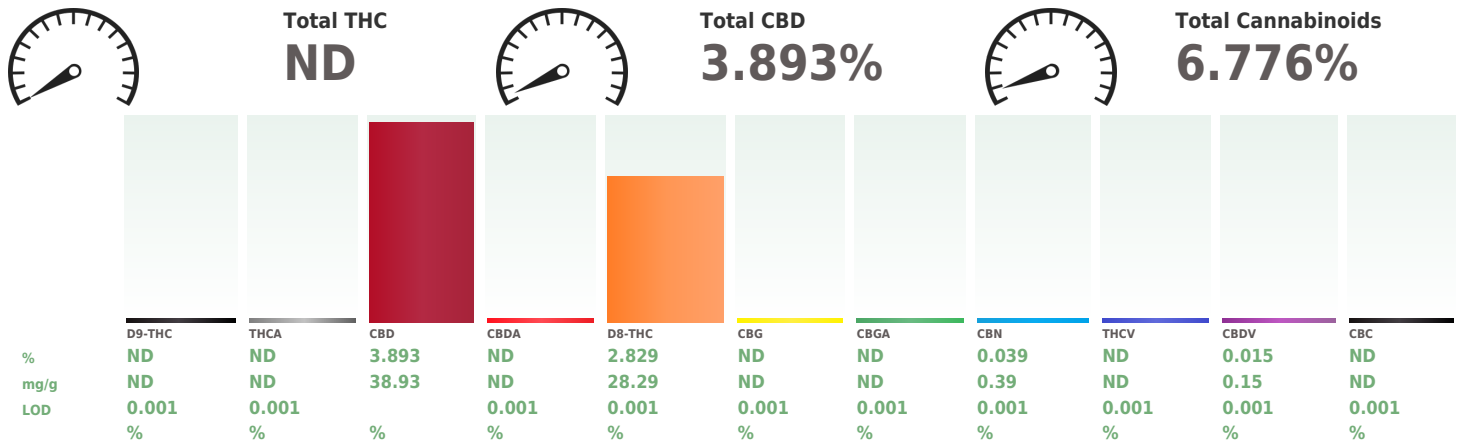

Analyzed by: 3335, 1665, 585, 1440 Weight: 3.0149g Extraction date: 12/29/23 11:44:23 Extracted by: 3335

Analysis Method : SOP.T.40.031, SOP.T.30.031 Reviewed On : 12/30/23 12:04:19
 Analytical Batch : DA067835POT Batch Date : 12/29/23 08:25:53
 Instrument Used : DA-LC-001
 Analyzed Date : 12/29/23 11:59:41

Dilution : 400
 Reagent : 120623.R45; 121923.R15; 060723.50; 060723.24; 121923.R12
 Consumables : 947.109; CE0123; 12594-247CD-247C; R1KB14270
 Pipette : DA-079; DA-108; DA-078

Full Spectrum cannabinoid analysis utilizing High Performance Liquid Chromatography with UV detection in accordance with F.S. Rule 64ER20-39.

This Kaycha Labs Certification shall not be reproduced, unless in its entirety, without written approval from Kaycha Labs. The results relate only to the material or product analyzed. ND=Not Detected, ppm=Parts Per Million, ppb=Parts Per Billion, RSD=Relative Standard Deviation. Limit of Detection (LOD) and Limit Of Quantitation (LOQ) are terms used to describe the smallest concentration that can be detected and reliably measured by an analytical procedure, respectively. Action Levels are State determined thresholds based on F.S. Rule 64ER20-39 and F.S. Rule 5K-4. The Measurement of Uncertainty (MU) error is available from the lab upon request. The "Decision Rule" for pass/fail does not include the MU. Any calculated totals may contain rounding errors.

Vivian Celestino
 Lab Director

State License # CMTL-0002
 ISO 17025 Accreditation # ISO/IEC
 17025:2017 Accreditation PJA-
 Testing 97164



Signature
 12/30/23